




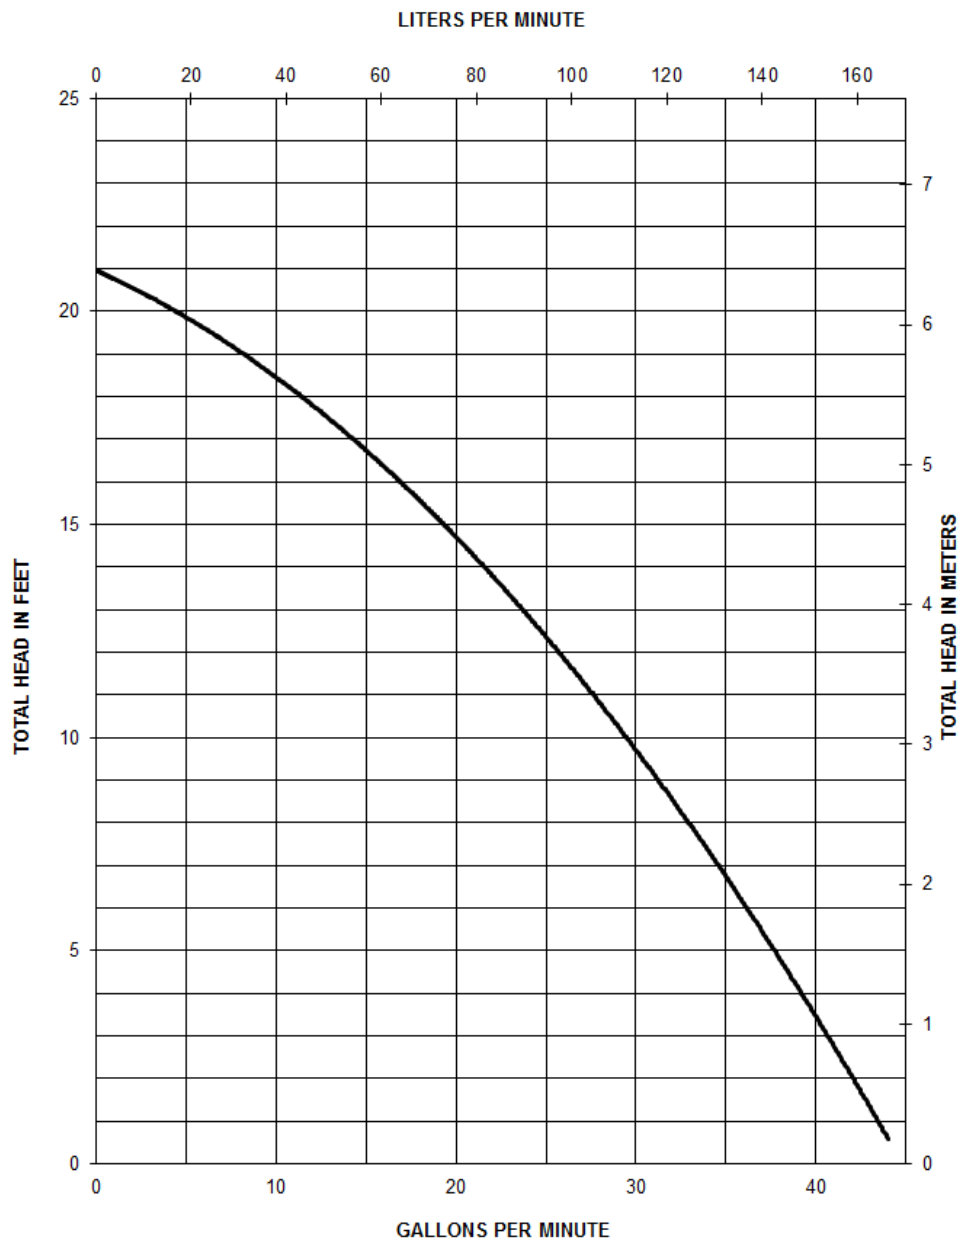


Pump Specifications



404 Series Drain Pump

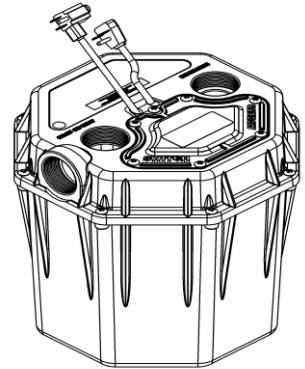

404-Series Dimensional Data

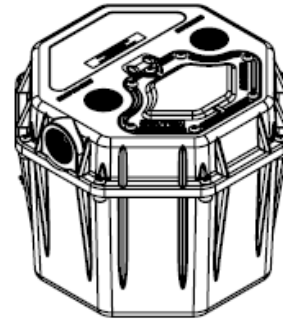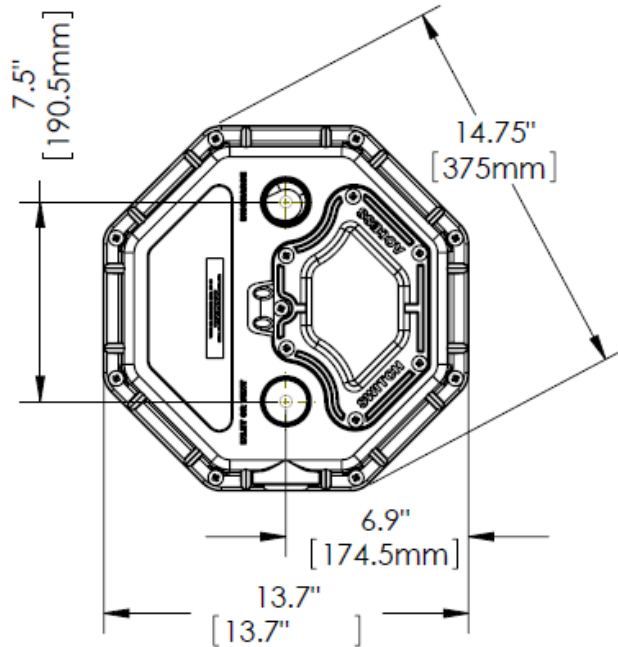

CORDS - 115V
PIGGY BACK - AUTOMATIC

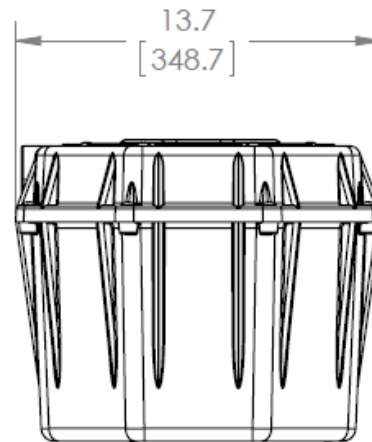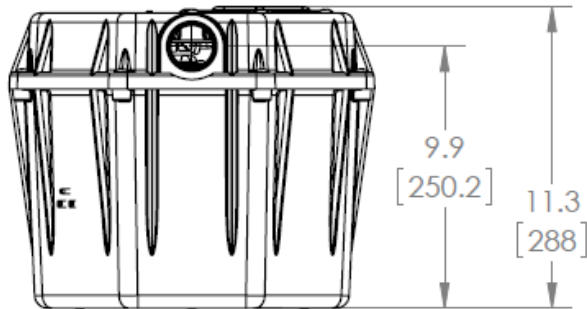

PROPRIETARY AND CONFIDENTIAL
THE INFORMATION CONTAINED IN THIS
DRAWING IS THE SOLE PROPERTY OF
LIBERTY PUMPS INC. ANY
REPRODUCTION IN PART OR AS A WHOLE
WITHOUT THE WRITTEN PERMISSION OF
LIBERTY PUMPS INC. IS PROHIBITED.

APPLICATION

DO NOT SCALE DRAWING

DWG. NO.

404 SERIES DIMENSIONAL

SIZE
A

JAN / 2007

REV.
A

SCALE: 1/4

WEIGHT: 23 LBS

SHEET 1 OF 1

404-Series Data

MODEL	HP	VOLTAGE	PH.	FULL LOAD AMPS	LOCKED ROTOR AMPS	THERMAL OVERLOAD TEMP	STATOR WINDING CLASS	CORD LENGTH FT.	DISCHARGE	AUTOMATIC	ALARM	CHECK VALVE
404	1/3	115	1	5.2	8	105°C / 221°F	B	10	1 1/2"	YES		
404CV	1/3	115	1	5.2	8	105°C / 221°F	B	10	1 1/2"	YES		YES
404/A	1/3	115	1	5.2	8	105°C / 221°F	B	10	1 1/2"	YES	YES	
404CV/A	1/3	115	1	5.2	8	105°C / 221°F	B	10	1 1/2"	YES	YES	YES
404/A-EYE	1/3	115	1	5.2	8	105°C / 221°F	B	10	1 1/2"	YES	YES NIGHTEYE®	
404CV/A-EYE	1/3	115	1	5.2	8	105°C / 221°F	B	10	1 1/2"	YES	YES NIGHTEYE®	YES
404L	1/3	115	1	5.2	8	105°C / 221°F	B	10	2"	YES		

404CV models are  Certified to UPC and IPC requirements of ASME A112.3.4 / CSA B45.9

404-Series Technical Data

IMPELLER	VORTEX HIGH TEMPERATURE ENGINEERED POLYMER
SOLIDS HANDLING	3/8"
PAINT (PUMP)	POWDER COAT
MAX LIQUID TEMP	40°C / 104°F CONTINUOUS, 60°C / 140°F INTERMITTENT
MAX STATOR TEMP	CLASS B 130°C / 266°F
THERMAL OVERLOAD	105°C / 221°F
POWER CORD TYPE	SJTW
MOTOR HOUSING	DEEP FINNED POWDER COATED ALUMINUM
VOLUTE	ENGINEERED POLYMER
SHAFT	STAINLESS
HARDWARE	STAINLESS
ORINGS	BUNA N
SHAFT SEAL	ENGINEERED DOUBLE LIP WITH STAINLESS SPRINGS
WEIGHT	13 LBS
TANK MATERIAL	POLYPROPYLENE
INLET SIZE	1 1/2" FEMALE NPT (2" FEMALE NPT on 404L)
DISCHARGE SIZE	1 1/2" FEMALE NPT (2" FEMALE NPT on 404L)
VENT SIZE	1 1/2" FEMALE NPT (2" FEMALE NPT on 404L)

404-Series Specifications

1.01 GENERAL:

The contractor shall provide labor, material, equipment, and incidentals required to provide _____ (QTY) commercial drain pumps as specified herein. The pump models covered in this specification are Series 404 single phase pumps. The pump furnished for this application shall be model _____ as manufactured by Liberty pumps, and have a maximum fluid temperature rating of 140 degrees F.

2.01 OPERATING CONDITIONS:

Each drain pump shall be rated at 1/3 hp _____ volts, single phase, 60 Hz. 3450 RPM. The unit shall produce _____ G.P.M. at _____ feet of total dynamic head.

The drain pump shall be capable of handling effluent with 3/8" solid handling capability. The drain pump shall have a shut-off head of 21 feet and a maximum flow of 38 GPM @ 5 feet of total dynamic head.

The pump shall be controlled with a piggy back style on/off float switch.

3.01 CONSTRUCTION:



Each drain pump shall be equal to the Series 404 with SA US Certified pump as manufactured by Liberty Pumps, Bergen NY. The motor housing shall be constructed of a deep finned powder coated aluminum. The motor housing shall be oil filled to dissipate heat. Air filled motors shall not be considered equal since they do not properly dissipate heat from the motor. All mating parts shall be machined and sealed with a Buna-N O-ring. All fasteners exposed to the liquid shall be stainless steel. The motor shall be protected on the top side with a sealed cord entry plate with molded pins to conduct electricity eliminating the ability of water to enter internally through the cord. The motor shall be protected on the lower side with an engineered double lip seal with stainless steel springs. The tank shall be made of polypropylene.

4.01 ELECTRICAL POWER CORD

The drain pump shall be supplied with 10 feet of multiconductor power cord. It shall be cord type SJTW, capable of continued exposure to the pumped liquid. The power cord shall be sized for the rated full load amps of the pump in accordance with the National Electric Code. The power cable shall not enter the motor housing directly but will conduct electricity to the motor by means of a water tight compression fitting cord plate assembly, with molded pins to conduct electricity. This will eliminate the ability of water to enter internally through the cord, by means of a damaged or wicking cord.

5.01 MOTORS

Single phase motors shall be oil filled, permanent split capacitor, class B insulated, NEMA B design, rated for continuous duty. At maximum load the winding temperature shall not exceed 130 degrees C unsubmerged. Since air filled motors are not capable of dissipating heat they shall not be considered equal. The pump motor shall have an integral thermal overload switch in the windings for protecting the motor. The capacitor circuit shall be mounted internally in the pump.

6.01 BEARINGS AND SHAFT

Upper and lower ball bearings shall be required. The bearings shall be a single ball / race type bearing. Both bearings shall be permanently lubricated by the oil, which fills the motor housing. The motor shaft shall be made of 300 or 400 series stainless steel and have a minimum diameter of .311".

7.01 SEALS

The pump shall have an engineered double lip seal with stainless steel springs. The motor plate / housing interface shall be sealed with a Buna-N o-ring.

8.01 IMPELLER

The impeller shall be molded engineered polymer, with pump out vanes on the back shroud to keep debris away from the seal area. It shall be threaded to the motor shaft.

9.01 CONTROLS

All units are supplied with CSA and UL approved automatic wide angle tilt float switches. The switches shall be equipped with piggy back style plug that allows the pump to be operated manually without the removal of the pump in the event that a switch becomes inoperable. The switches shall be mounted under a separately sealed access cover and tethered to a removable stainless steel rod for easy removal and serviceability.

10.01 PAINT

The exterior of the casting shall be protected with powder coat paint.

11.01 SUPPORT

The polyolefin tank shall be a free standing unit.

12.01 SERVICEABILITY

Components required for the repair of the pump shall be shipped within a period of 24 hours.

13.01 TESTING

The pump shall have a ground continuity check and the motor chamber shall be Hi-potted to test for electrical integrity, moisture content and insulation defects. The motor and volute housing shall be pressurized, and an air leak decay test is performed to ensure integrity of the motor housing. The pump shall be run, voltage current monitored, and the tester checks for noise or other malfunction.

14.01 QUALITY CONTROL

The pump shall be manufactured in an ISO 9001 certified Facility.

15.01 WARRANTY

Standard limited warranty shall be 3 years.