


## Instruction Leaflet for Plug-in Block for EG, JG and LG frame Circuit Breakers


### WARNING

**DO NOT ATTEMPT TO INSTALL OR PERFORM MAINTENANCE ON EQUIPMENT WHILE IT IS ENERGIZED. DEATH, SEVERE PERSONAL INJURY, OR SUBSTANTIAL PROPERTY DAMAGE CAN RESULT FROM CONTACT WITH ENERGIZED EQUIPMENT. ALWAYS VERIFY THAT NO VOLTAGE IS PRESENT BEFORE PROCEEDING WITH THE TASK, AND ALWAYS FOLLOW GENERALLY ACCEPTED SAFETY PROCEDURES.**

### ① Plug-in Block Assembly

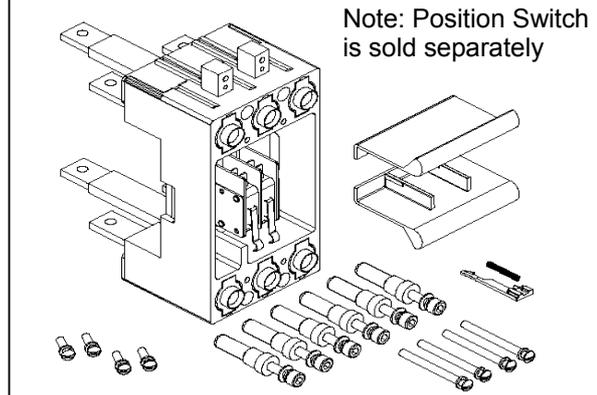


### ② Cutout and Drilling Plan for Mounting Panel

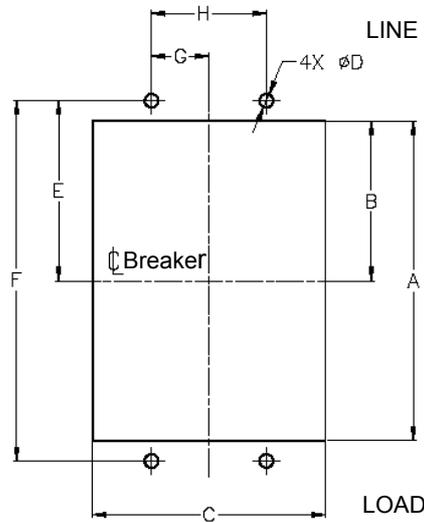


Cat. No.	Type Bkr.	A	B	C	E	F	G	H	ØD
PAD3E	EG-3P	142	71	78	80	160	12.7	25.4	4.5
PAD4E	EG-4P	142	71	103	80	160	25.4	50.8	4.5
PAD3J	JG-3P	190	95	107	104	208	17.5	35	5.5
PAD4J	JG-4P	190	95	142	104	208	35	70	5.5
PAD3L	LG-3P	274	137	142	148	296	22	44	6.5
PAD4L	LG-4P	274	137	186	148	296	44	88	6.5


③ Install Plug-in Block on Mounting Panel

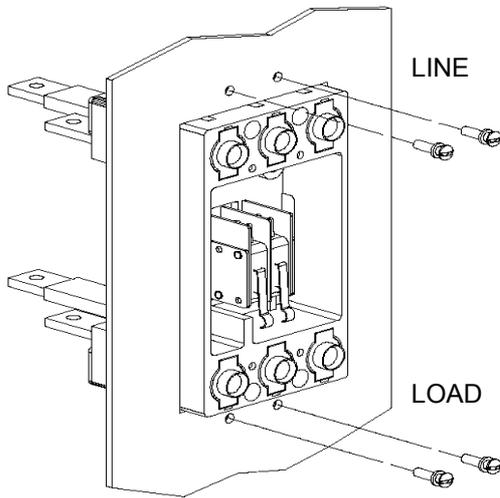


④ Assemble Plugs to Breaker's Conductor

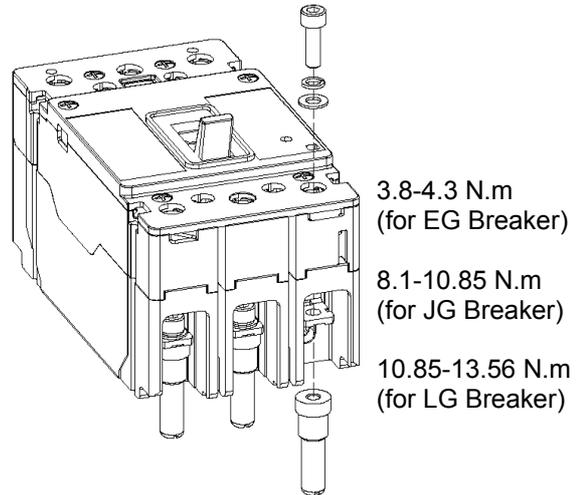


⑤ Insert Plug-in Interlock into Circuit Breaker

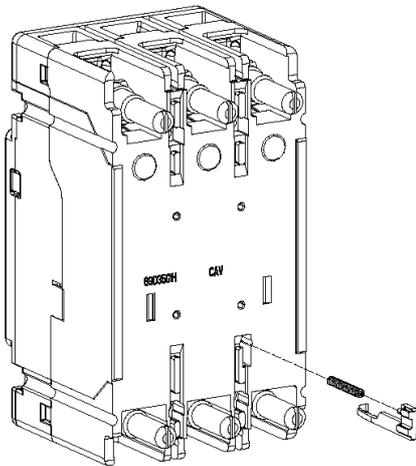


⑥ Press Shield to Circuit Breaker

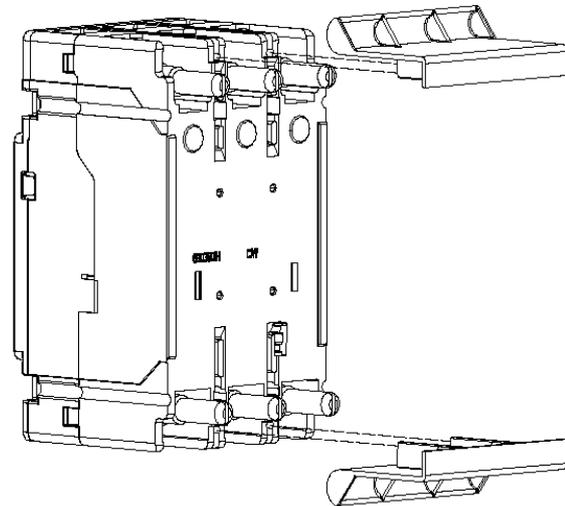


⑦ Mount Circuit Breaker to Plug-in Block

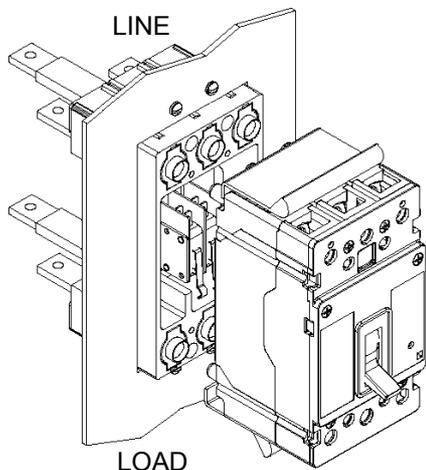

⑧ Secure Circuit Breaker to Plug-in Block

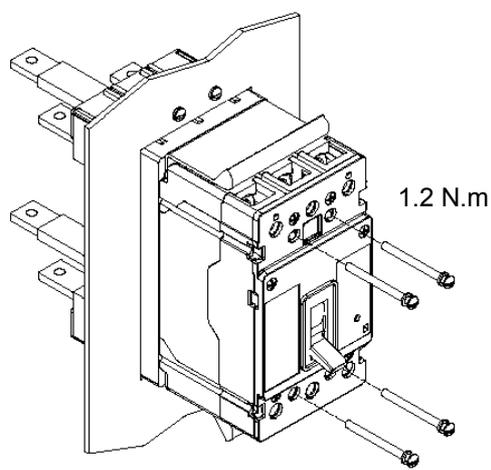

⑨ Outline of Plug-in Block Assembled to Breaker

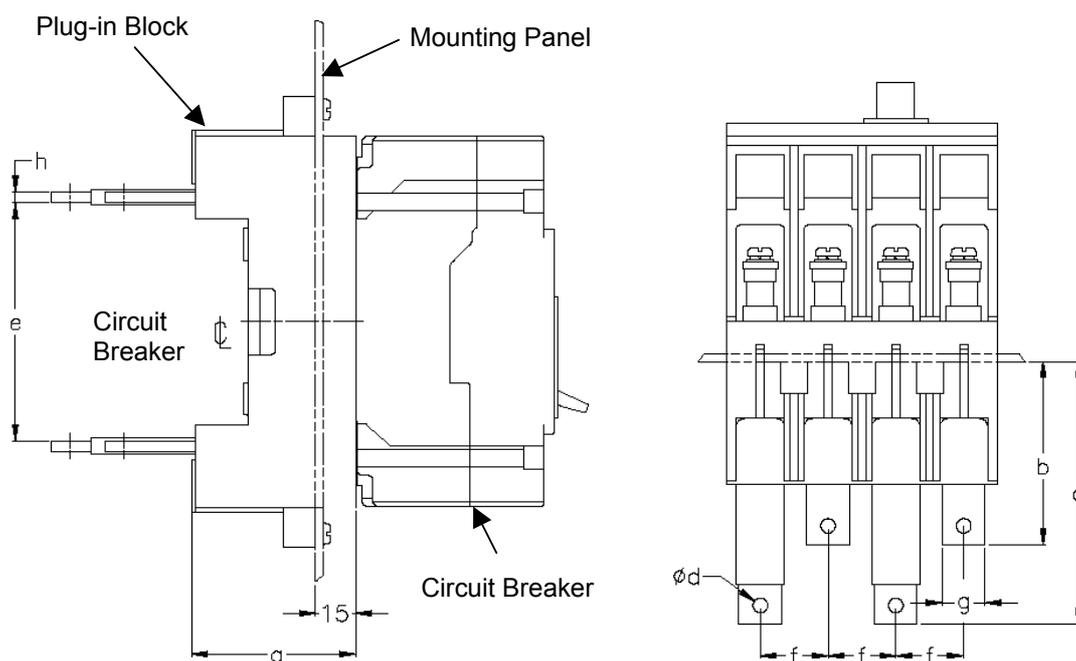

Cat. No	a	b	c	e	f	g	h	Ød
PAD3E / PAD4E	60	65	120	90	25.4	16	4	5.5
PAD3J / PAD4J	70	90	140	123	35	20	5	9
PAD3L / PAD4L	90	121	181	170	44	30	10	13

