

R5710

# REED INSTRUMENTS

## Clamp-On Ground Resistance Tester



## Instruction Manual



[www.REEDInstruments.com](http://www.REEDInstruments.com)

# Table of Contents

Introduction .....	3
Product Quality.....	3
Safety .....	3
Features.....	4
Included.....	4
Specifications.....	5-6
Instrument Description .....	7
Display Description .....	7
Operating Instructions.....	8-12
<i>Power ON/OFF</i> .....	8
<i>Auto Power OFF</i> .....	9
<i>Resistance/Ground Leakage Measurement Mode</i> .....	9
<i>Resistance Measurement Mode</i> .....	9-10
<i>Data Hold &amp; Memory Storage</i> .....	11
<i>Memory Recall</i> .....	11-12
<i>Setting the Critical Alarms</i> .....	12
Battery Replacement.....	13
Product Care .....	13
Product Warranty .....	14
Product Disposal and Recycling .....	14
Product Support.....	14

## Introduction

Thank you for purchasing your REED R5710 Ground Resistance Tester. Please read the following instructions carefully before using your instrument. By following the steps outlined in this manual your meter will provide years of reliable service.

## Product Quality

This product has been manufactured in an ISO 9001 facility and has been calibrated during the manufacturing process to meet stated product specifications. If a certificate of calibration is required please contact the nearest authorized REED distributor or authorized Service Center. Please note an additional fee for this service will apply.

## Safety

- Never attempt to repair or modify your instrument. Dismantling your product, other than for the purpose of replacing batteries, may cause damage that will not be covered under the manufacturer's warranty. Servicing should only be provided by an authorized service center.
- Be aware of your surroundings, environment and measurement scope.
- If the instrument applies to ground resistance testing instead of current power frequency wire it will affect the clamps magnetic property and the accuracy of measurement.
- Before turning on the unit, press on the trigger a couple of times to confirm it can properly open and close.
- Do not press the trigger or clamp any wires when turning on the instrument.
- Only clamp the tested desired object after the display shows "OL  $\Omega$ ".
- Keep the contact surface of the jaws clean and refrain from using harsh cleaning products.
- When taking measurements the instrument will sporadically "hum".
- Do not exceed the max measurements.
- If instrument will not be used for a prolonged amount of time, remove the battery.
- If something is damaged, immediately stop using the instrument.

## Features

- Auto-ranging ground resistance and leakage current measurements
- 0.001 $\Omega$  resolution for low resistance measurements
- 9999-count EBTN display
- Internal memory stores up to 300 readings
- User adjustable alarms
- Data hold function
- Durable double molded conductor clamp
- 1.26" (32mm) jaw size for large ground rods
- Low battery indicator and auto shut off
- Cat. III 300V safety rating

## Included

- Resistance Calibration Loop (1 $\Omega$  and 10 $\Omega$ )
- Hard Carrying Case
- Batteries

# Specifications

## Ground Resistance

Ranges:	0.010 to 0.099 $\Omega$ 0.10 to 0.99 $\Omega$ 1.0 to 49.9 $\Omega$ 50.0 to 99.5 $\Omega$ 100 to 199 $\Omega$ 200 to 395 $\Omega$ 400 to 590 $\Omega$ 600 to 880 $\Omega$ 900 to 1200 $\Omega$
Accuracy:	0.010 to 0.099 $\Omega$ : $\pm(1\% + 0.01\Omega)$ 0.10 to 0.99 $\Omega$ : $\pm(1\% + 0.01\Omega)$ 1.0 to 49.9 $\Omega$ : $\pm(1\% + 0.1\Omega)$ 50.0 to 99.5 $\Omega$ : $\pm(1.5\% + 0.5\Omega)$ 100 to 199 $\Omega$ : $\pm(2\% + 1\Omega)$ 200 to 395 $\Omega$ : $\pm(5\% + 5\Omega)$ 400 to 590 $\Omega$ : $\pm(10\% + 10\Omega)$ 600 to 880: $\pm(20\% + 20\Omega)$ 900 to 1200 $\Omega$ : $\pm(25\% + 30\Omega)$
Resolution:	0.001 $\Omega$ 0.01 $\Omega$ 0.1 $\Omega$ 1 $\Omega$ 0.5 $\Omega$ 1 $\Omega$ 5 $\Omega$ 10 $\Omega$ 20 $\Omega$ 30 $\Omega$

*continued...*

## Current


Ranges:	0 to 9mA 10 to 99mA 100 to 299mA 0.30 to 2.99A 3 to 9.9A 10 to 20A
Accuracy:	0 to 9.95A: $\pm(2.5\% + 1\text{mA})$ 10 to 99mA: $\pm(2.5\% + 5\text{mA})$ 100 to 300mA: $\pm(2.5\% + 10\text{mA})$ 0.30 to 2.99A: $\pm(2.5\% + 0.1\text{A})$ 3 to 9.9A: $\pm(2.5\% + 0.3\text{A})$ 10 to 20A: $\pm(2.5\% + 0.5\text{A})$
Resolution:	0.5mA, 0.1mA, 1mA, 0.01A, 0.1A, 0.1A

## General Specifications

Range Selection:	Auto-ranging
Sampling Time:	0.5 seconds
Display:	9999 count EBTN display
Backlit LCD:	Yes
User Selectable Alarms:	Yes
Display Hold:	Yes
Internal Memory:	Yes up to 300 data points
Auto Shut-off:	Yes (after 5 minutes)
Power Supply:	4 x AA Batteries
Over Range Indicator:	Yes
Low Battery Indicator:	Yes
$\Omega$ +A Display:	Yes
Jaw Opening:	1.26" (32mm)
Overvoltage Category:	CAT. III 300V
Product Certifications:	CE, RoHS
Operating Temperature:	32 to 131°F (0 to 55°C)
Operating Humidity:	10 to 90%
Storage Temperature:	-4 to 140°F (-20 to 60°C)
Dimensions:	11.2 x 3.3 x 2.2" (285 x 85 x 56mm)
Weight:	2.6lbs (1180g)

## Instrument Description

1. Clamp Jaw Assembly
2. Data Hold Button
3. Measurement Trigger
4. LCD Display
5. Multi-Function Buttons

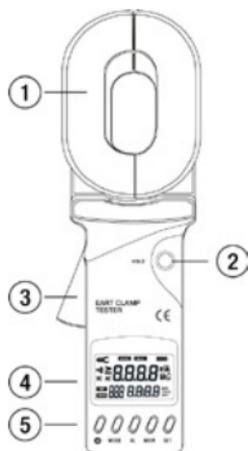

## Display Description



- |                                     |                                   |
|-------------------------------------|-----------------------------------|
| 1. Noise Signal Indicator           | 7. Current Measurement Value      |
| 2. Data Hold Indicator              | 8. Number of Stored Values        |
| 3. Battery Status Indicator         | 9. Internal Memory Full Indicator |
| 4. Resistance Measurement Indicator | 10. Data Inquiry Indicator        |
| 5. Resistance Measurement Value     | 11. Alarm Indicator               |
| 6. Current Measurement Indicator    | 12. Clamp Jaw Open Indicator      |

# Operating Instructions

## Power ON/OFF

1. To turn the instrument ON/OFF press the  button.
2. At power up, the LCD display will light up while displaying the symbols shown below.



3. During that time, the instrument will also go through a quick internal calibration and enter resistance/ground leakage measurement mode if it passes. Refer to *Resistance/Ground Leakage Measurement Mode* for details.

**Note:** The instrument automatically enters the resistance/earth leakage measurement mode at start up regardless of the last saved setting.

**Note:** DO NOT clamp on to any conductor or open the clamp jaws during the start-up self-calibration.

4. If the instrument does not pass calibration, the LCD display will indicate "ER" as shown below.



**Note:** This error could be caused by the clamp jaw not being properly closed or from any dirt build up on the metal surface of the jaw clamp.

*continued...*

## Auto Power OFF

To preserve battery life, the instrument is programmed to turn itself OFF after 5 minutes of inactivity. Prior to the instrument turning OFF, the LCD display will blink for approximately 30 seconds. Press the  button to delay the auto power OFF function and resume normal operation.

## Resistance/Ground Leakage Measurement Mode

1. When instrument is turned on and passes calibration, "OL  $\Omega$ " and "0.00 mA" appears on the LCD display as shown below confirming that you can now measure the resistance/earth leakage simultaneously.



2. Pull the trigger to open the clamp and clamp onto the circuit under test.
3. The LCD will display the resistance and ground leakage current measurement values.
4. If the instrument beeps and the LCD display flashes, the measurement values are exceeding the critical set alarm. Refer to Setting the Critical Alarms for details.

## Resistance Measurement Mode


1. After the instrument has powered up and passed calibration, press the **MODE** button to enter the resistance only measurement mode.
2. "OL  $\Omega$ " appears on the LCD display as shown below confirming that you can now measure the resistance.

*continued...*




3. Pull the trigger to open the clamp and clamp onto the circuit under test.
4. The LCD will display the resistance value.
5. If the instrument beeps and the LCD display flashes, the resistance measurement is exceeding the critical set alarm. Refer to Setting the Critical Alarms for details.

Ground resistance measurements principle:

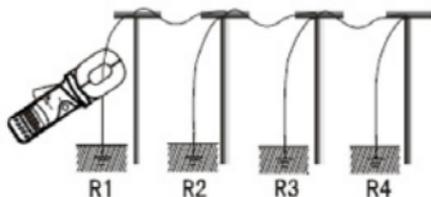

Equivalent circuit diagram:

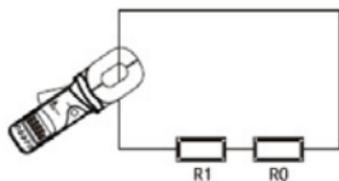

*continued...*

## Data Hold & Memory Storage

The instrument has the capability of storing up to 300 values. Stored values are not lost when instrument is turned on or off.

1. While taking a measurement, press the **HOLD** button to save the current reading.
2. While in this mode "HOLD" will appear along with the current stored value and sequence number.



3. Press the button again to resume normal operation.

**Note:** When the Data Hold feature is active the instrument will not turn OFF.

4. Repeat steps 1 to 3 to hold/store new values during testing.

**Note:** When the memory is full, "MEM" will flash on the LCD display as shown below.



## Memory Recall

In order to recall the stored values, you must follow the steps below:

1. Press the **MEM** button to enter memory recall mode and the first stored value will be displayed.



*continued...*

2. Press the **AL** and **SET** buttons to scroll through the stored values.
3. To clear the stored values, press and hold the MEM button first and then press the  button.

**Note:** If no values are stored or if the memory is cleared the display will appear as shown below.



4. Press the MEM button to exit memory recall mode and resume normal operation.

### *Setting the Critical Alarms*

1. Press the **AL** button to turn the critical alarm mode ON or OFF.
2. Hold the **SET** button for approximately 3 seconds to enter the critical alarm set up mode.
3. Press the **SET** button to toggle between digits.
4. Press the **AL** and **MEM** buttons to adjust the flashing digit.

**Note:** The maximum set critical alarm value that can be set is 199 $\Omega$ /499mA.

5. Press the **SET** button to confirm your selection and proceed to the next digit.
6. When complete, hold the **SET** button for approximately 3 seconds to exit the critical alarm set up mode and resume normal operation.

**Note:** When the critical alarm is enabled, the instrument will begin to beep if the measured value exceeds the selected alarm.

7. Follow steps 2 to 6 to set the critical alarm in mA.

## Battery Replacement

When the  icon appears on the LCD display, you will need to replace the batteries. Remove the battery cover using a Phillips head screwdriver, insert 4 x new AA batteries and secure the cover.

## Product Care

To keep your instrument in good working order we recommend the following:

- Store your product in a clean, dry place.
- Change the battery as needed.
- If your instrument isn't being used for a period of one month or longer please remove the battery.
- Clean your product and accessories with biodegradable cleaner. Do not spray the cleaner directly on the instrument. Use on external parts only.

## Product Warranty

REED Instruments guarantees this instrument to be free of defects in material or workmanship for a period of one (1) year from date of shipment. During the warranty period, REED Instruments will repair or replace, at no charge, products or parts of a product that proves to be defective because of improper material or workmanship, under normal use and maintenance. REED Instruments total liability is limited to repair or replacement of the product. REED Instruments shall not be liable for damages to goods, property, or persons due to improper use or through attempts to utilize the instrument under conditions which exceed the designed capabilities. In order to begin the warranty service process, please contact us by phone at 1-877-849-2127 or by email at [info@reedinstruments.com](mailto:info@reedinstruments.com) to discuss the claim and determine the appropriate steps to process the warranty.

## Product Disposal and Recycling



Please follow local laws and regulations when disposing or recycling your instrument. Your product contains electronic components and must be disposed of separately from standard waste products.

## Product Support

If you have any questions on your product, please contact your authorized REED distributor or REED Instruments Customer Service by phone at 1-877-849-2127 or by email at [info@reedinstruments.com](mailto:info@reedinstruments.com).

Please visit [www.REEDINSTRUMENTS.com](http://www.REEDINSTRUMENTS.com) for the most up-to-date manuals, datasheets, product guides and software.

*Product specifications subject to change without notice.  
All rights reserved. Any unauthorized copying or reproduction of this manual is strictly prohibited without prior written permission from REED Instruments.*

# REED

## INSTRUMENTS

### TEST & MEASURE WITH CONFIDENCE



**CHECK OUT OUR LATEST PRODUCTS!**

[www.REEDInstruments.com](http://www.REEDInstruments.com)

# REED INSTRUMENTS

TEMPERATURE  
& HUMIDITY



SOUND



MOISTURE



AIR VELOCITY



ELECTRICAL



[www.REEDInstruments.com](http://www.REEDInstruments.com)