


ULP module



Modbus SL com interface
Interface de Com Modbus SL
Interf comunicación Modbus SL

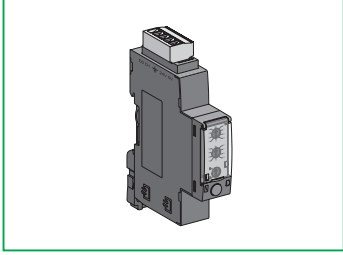

Schneider
Electric

GHD16323AA-05

Schneider Electric Industries SAS
35, rue Joseph Monier
CS 30323
F - 92506 Rueil Malmaison Cedex

www.schneider-electric.com



© 2009 Schneider Electric.
All rights reserved.

IMPORTANT NOTE

- This device must be installed by a qualified electrician.
- We cannot accept any responsibility for failure to follow the instructions provided in this document.

REMARQUE IMPORTANTE


- L'installation de cet appareil doit être effectuée par des professionnels de l'électricité.
- Le non-respect des indications de la présente notice ne saurait engager la responsabilité du constructeur.

OBSERVACIÓN IMPORTANTE

- La instalación y mantenimiento de este aparato sólo debe ser realizado por electricistas profesionales.
- El fabricante no se hace responsable en caso de no cumplir con las indicaciones expuestas en este aviso.

重要注意事項

- 本装置必须由合格的电工进行安装。
- 我们不承担任何因未遵循本文档中的指南而导致的责任。

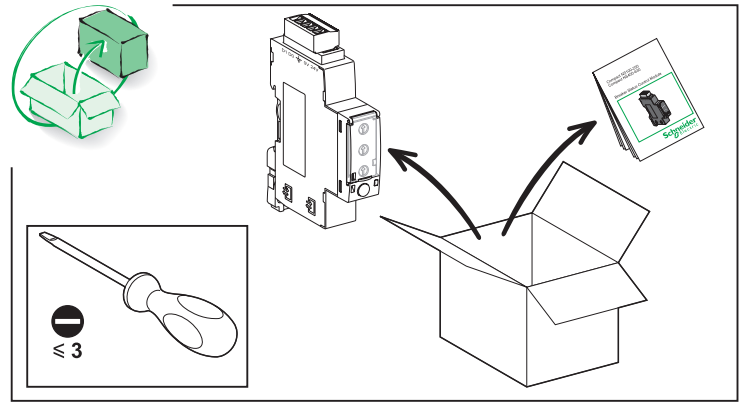




ULP system User Manual

www.schneider-electric.com



TRV99100 (fr)

TRV99101 (en)

TRV99102 (es)

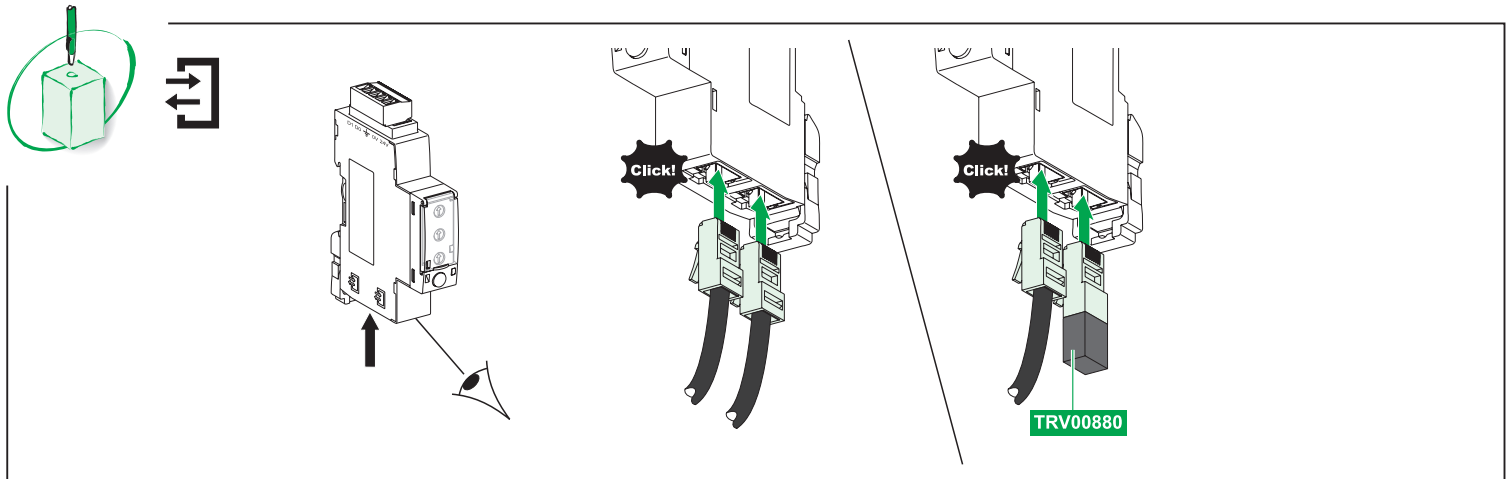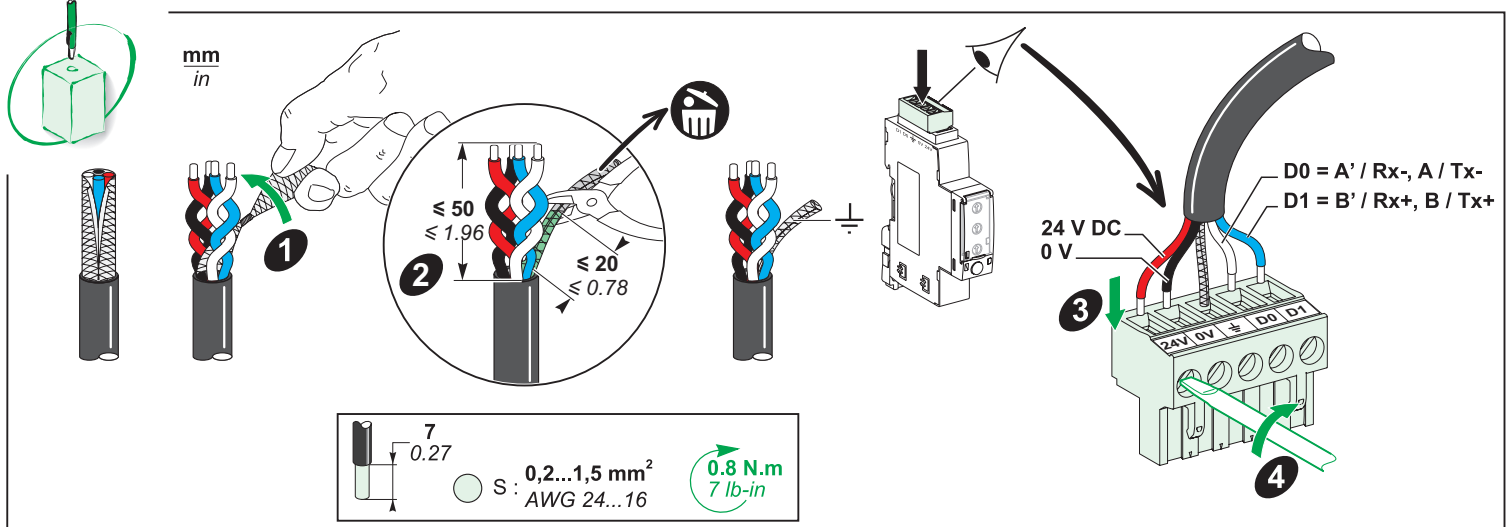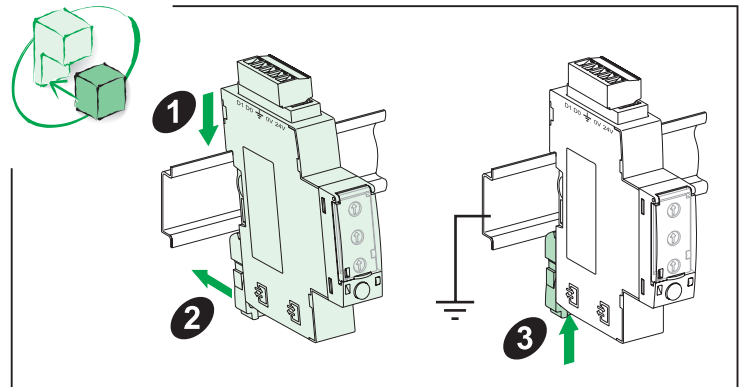

GHD16323AA-05

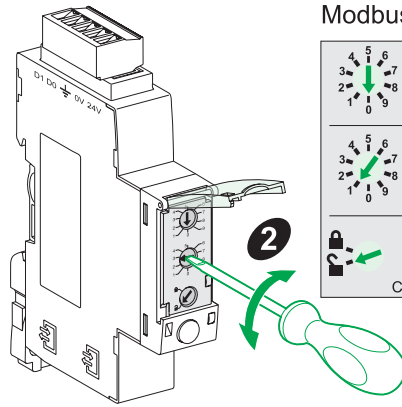
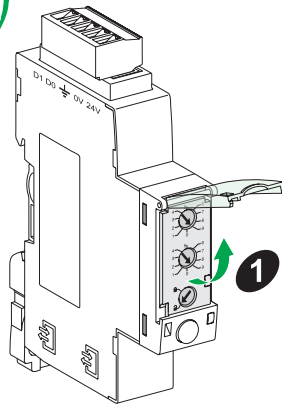


Modbus address 01...99





Modbus address



$$\begin{matrix} \downarrow 0 \\ \times 10 \end{matrix} + \begin{matrix} \downarrow 1 \\ \times 1 \end{matrix} = 01$$

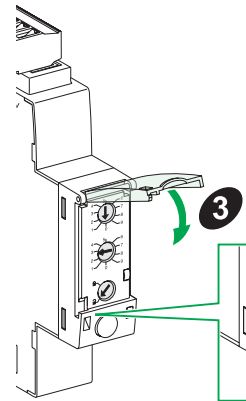







0 V 24 V DC

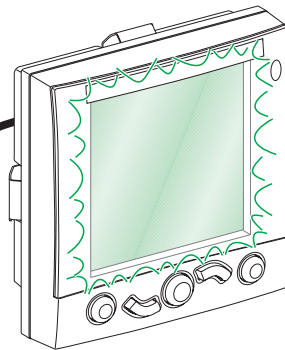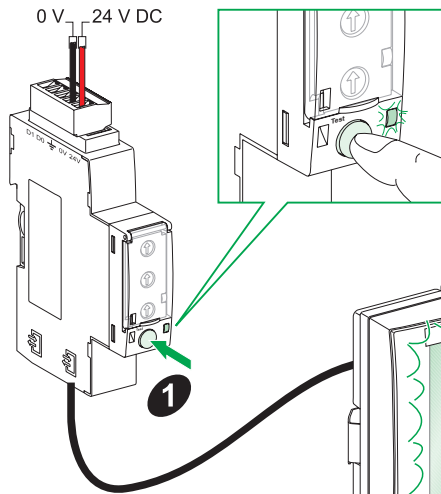

NSX cord

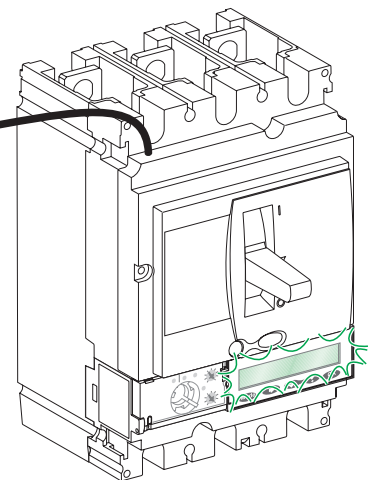

TRV00217

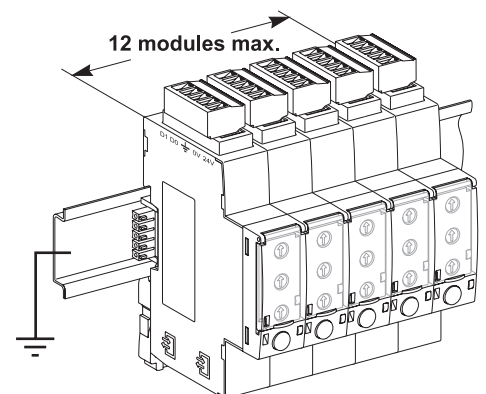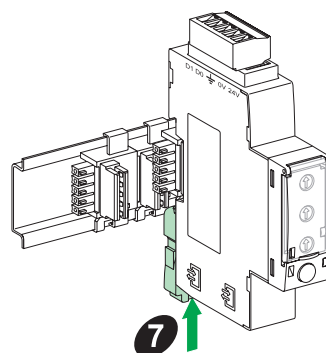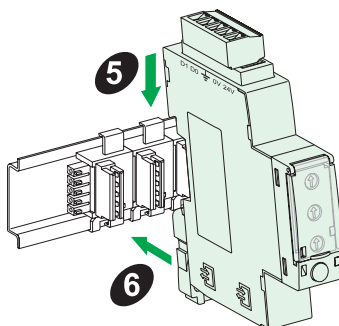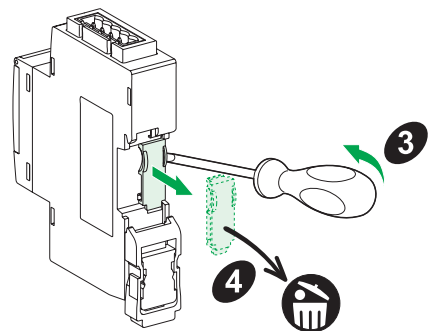

12 modules max.